

SALES AREA

Floor Surface

Floor mats must not exceed 1/2 inch in height.


Floor mats must be secure, and must not slide.

Carpet must be low pile (maximum 1/2 inch), and tightly woven.

Carpeting must be attached along all edges.

Sales Counter & Turnaround Area

Sales counter must not exceed 36 inches in height.

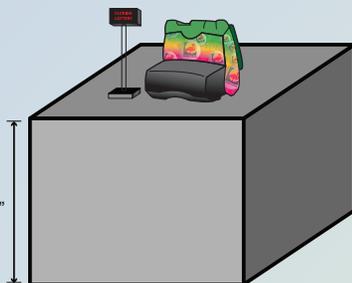

enough space in a for a person using to approach and Turning diameter t least 5 feet.



From the parking lot to the point of purchase, removing barriers between your customers and your cash register is good for everyone- ESPECIALLY YOU!

When you consider the additional profits your business can generate by being accessible to all of Florida's residents and visitors, accessibility just makes GOOD BUSINESS SENSE.

ADDITIONAL RESOURCES

Florida Accessibility Code for Building Construction:

www.dca.state.fl.us/fbc/information/accessibility.htm

United States Department of Justice; ADA:

www.usdoj.gov/crt/ada/adahom1.htm

United States Access Board:

www.access-board.gov

For additional information or questions relating to the accessibility requirements of Florida Lottery retailers, please contact the Lottery's ADA Coordinator at (850) 487-7777, extension 3700.

This document is available in an alternative format as an accommodation to people with disabilities. Contact the Public Information Office, Florida Lottery, 250 Marriott Drive, Tallahassee, Florida 32399-4016, (850) 487-7787; TDD (850) 487-7784 for the hearing impaired.



When You Play, We All Win!
flalottery.com

Effective Date: 10/01/2007



REQUIREMENTS FOR LOTTERY RETAILERS



The Florida Lottery is committed to ensuring that all retail outlets marketing its products meet the accessibility requirements of the Americans with Disabilities Act (ADA) and the Florida Accessibility Code for Building Construction. The principal components of these requirements, as they relate to the sale of lottery tickets, are provided here to assist you in determining if your location is accessible to people with disabilities.

DISABLED PARKING SPACES

How Many?

Refer to the table below to determine the required number of disabled parking spaces.

Total Parking Spaces	Disabled Spaces
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1000	2% of total
1001 & Over	20 + 1 for each 100 over 1000

Space Requirements for Parking


- Must be at least 12 feet wide.
- Must be prominently outlined in blue.

Access Aisles

- Must be at least 5 feet wide.
- Must be placed adjacent to disabled parking space.
- Must be striped diagonally (white is recommended) to designate it as a no-parking zone.
- Two disabled spaces may share a common access aisle.

Maintenance

Both the disabled parking space and access aisle must be re-painted when necessary to be clearly distinguishable as a parking space designated for people with disabilities.

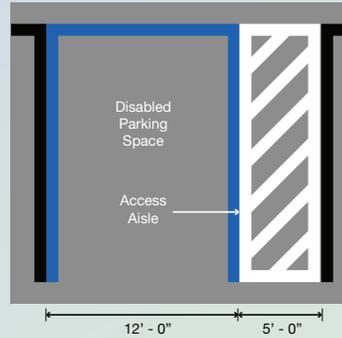


Signs

Must be 84 inches high measured from the ground to the bottom of the sign.

Must display the International Symbol of Accessibility.

Must provide the caption "PARKING BY DISABLED PERMIT ONLY".

Must include the penalty for illegal use.

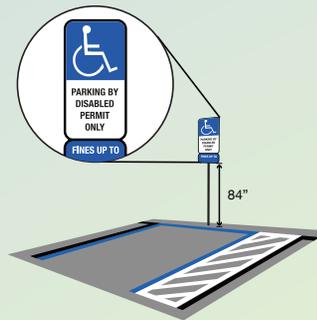

CURBS & CURB RAMPS


Path of Travel

A curb ramp is required if the path of travel from the parking lot to the sales counter crosses a curb.

Curb Ramp

Rise must be no greater than a height-to-length ratio of 1:12, i.e., one foot of ramp length is needed for each inch the ramp rises. For example, a ramp that is five inches high, must be at least 5 feet in length.

Must be at least 36 inches wide and be located outside of disabled parking spaces and access aisles.



Must be clear of obstacles in the pathway, i.e. parked vehicles, dumpsters, etc.

PATH OF TRAVEL

Steps & Stairs

Must provide a surface that is non-slip, i.e. rough concrete, non-slip paint, or rubber treads.

Must have hand-rails on both sides.

Travel Surface

Must be stable, firm and slip-resistant.

Width

Except at doorways and gates, all pathways must be at least 36 inches wide at their narrowest point.

Height

Overhead objects must be higher than 80 inches from the ground or floor.

DOORS & DOORWAYS

Doors

Must be able to be opened with a closed fist.

Force to open exterior doors must not exceed 8.5 lbs.

Force to open interior doors must not exceed 5 lbs.

From a normal open position, it must take at least 3 seconds for the door to close.

There must be at least 18 inches of clear space on the latch-side of the door.

Doorways

With the main door open, the doorway must provide at least 32 inches of clear opening.

Standard door thresholds must not exceed 1/4 inch in height.

Beveled thresholds must not exceed 1/2 inch in height.